



# LP GAS PLAN REVIEW FORM



## INSTALLATION CONCERN INFORMATION

Concern Name:		Contact Person:	
Physical Address:			
Mailing Address:			
Telephone:		Fax:	
Service Description:		Type of Vehicle Protection:	
Above Ground <input type="checkbox"/>	Under Ground <input type="checkbox"/>	Foundation, Footing, or Backfill:	

## LICENSED LP GAS INSTALLER INFORMATION


Company Name:	
Physical Address:	
Mailing Address:	Telephone:
Contact Person:	Fax:

## REQUIRED INFORMATION

Information shall be submitted only by a Utah licensed LP Gas installer and shall include the original drawings or readable copy. **Do not** send faxes without prior approval from the Fire Marshal's office. Insufficient information, non-readable copy or non-payment of fees will be cause for rejection of plans.

Provide a copy of the approval from the authority having jurisdiction: Building, Planning, Zoning, and/or Fire Department.

## SAMPLE DRAWING

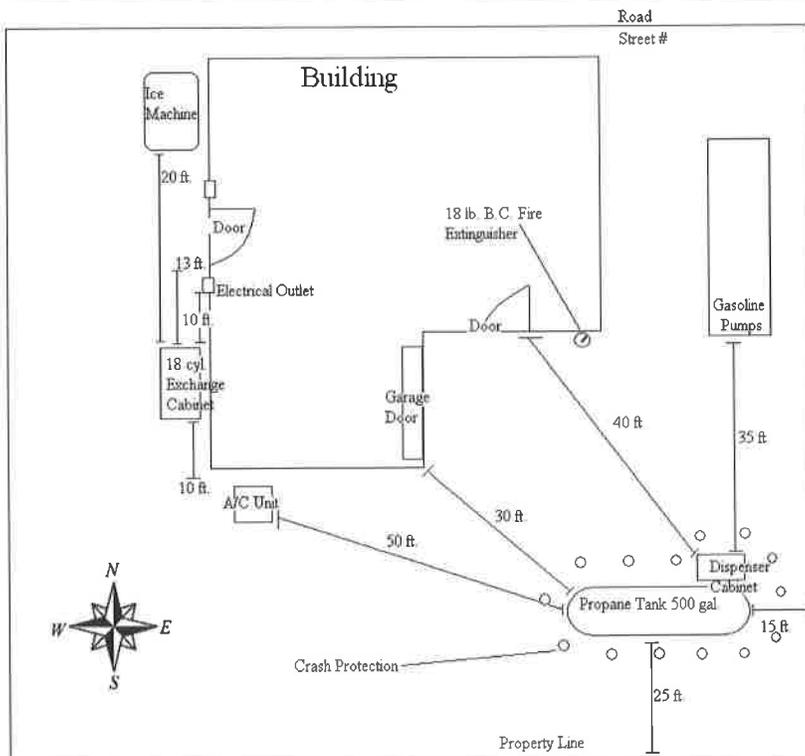

Installation of tank and piping as per **NFPA 58 (2008)**, **NFPA 54 (2006)**, and the **International Fire Code (2006 Edition) Article 38**.

Type of approved vehicle protection to be used. Guard posts or other approved means of protection for tank and piping shall be provided. **International Fire Code (2006 Edition) section 312**.

Guard posts shall be constructed of steel not less than 4 inches in diameter and concrete filled, spaced no more than 4 feet apart, set no less than 3 feet deep in a concrete footing of not less than a 15 inch diameter, with the top of the posts not less than 3 feet above the ground, and not less than 3 feet from the tank.

Type(s) of security and protection against tampering to be provided.

Provide location of fire extinguisher within 75 feet of dispenser. **Minimum 18 lb B.C. rating**.

Provide signage: **No Smoking, Propane, and Flammable Gas**.

**PLAN REVIEW DRAWING INSTRUCTIONS**

The plan or sketch is to include:

Size of tank(s) to be installed (water gallons), distance from tank to property lines, existing buildings, streets, roads and sidewalks, overhead power lines, and all sources of ignition in all directions.

Type of approved vehicle protection to be used. Guard posts or other approved means of protection for tank and piping shall be provided. International Fire Code (2006 Edition) section 312.

Location of minimum 18 lb. B.C. fire extinguisher within 75 feet of dispenser.

**PLAN REVIEW DRAWING**

