



# LP GAS PLAN REVIEW FORM



Submission Date \_\_\_\_\_

## INSTALLATION CONCERN INFORMATION

Concern Name (Business): \_\_\_\_\_ Contact Person: \_\_\_\_\_

Physical Address: \_\_\_\_\_

Telephone: \_\_\_\_\_ Email Address: \_\_\_\_\_

## LICENSED LP GAS INSTALLER INFORMATION

Company Name: \_\_\_\_\_ Contact Person: \_\_\_\_\_

Physical Address: \_\_\_\_\_

Telephone: \_\_\_\_\_ Email Address: \_\_\_\_\_

## LP GAS INSTALLATION INFORMATION


Resale Cylinder Exchange	# of Cages	# of Cylinders per cage			
Dispenser	Horizontal	Vertical	Own Use	Resale	Tank Size
Bulk Tank/ Systems Over 5,000 Gal		Above Ground	Under Ground	Tank(s) Size	
Other LP Gas Installations		Above Ground	Under Ground	Tank(s) Size	

## REQUIRED INFORMATION

Information shall be submitted only by a Utah licensed LP Gas installer and shall include the original drawings or readable copy. Insufficient information, non-readable copy or non-payment of fees will be cause for rejection of plans. Provide a copy of the approval from the authority having jurisdiction: Building, Planning, Zoning, and/or Fire Department. Local Authority Having Jursdiction:

Contact: \_\_\_\_\_ Phone: \_\_\_\_\_ Email: \_\_\_\_\_

## SAMPLE DRAWING

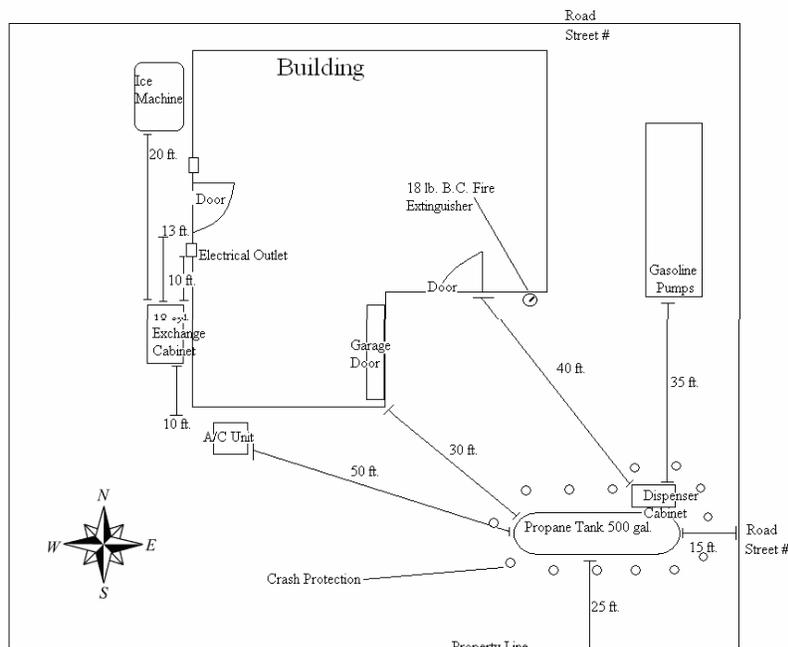

Installation of tank and piping as per **NFPA 58 (2024), IFGC (2021), and the International Fire Code (2021 Edition) Chapter 61**

Type of approved vehicle protection to be used. Guard posts or other approved means of protection for tank and piping shall be provided. **International Fire Code (2018 Edition) section 312 and NFPA 58 (2017 Edition).**

Guard posts shall be constructed of steel not less than 4 inches in diameter and concrete filled, spaced no more than 4 feet apart, set no less than 3 feet deep in a concrete footing of not less than a 15 inch diameter, with the top of the posts not less than 3 feet above the ground, and not less than 3 feet from the tank.

Type(s) of security and protection against tampering to be provided.

Provide location of fire extinguisher within 50 feet of dispenser. **Minimum 18 lb ABC rating.** Provide signage: **No Smoking, Propane, and Flammable Gas.**

**PLAN REVIEW DRAWING INSTRUCTIONS**

The plan or sketch is to include:

Size of tank(s) to be installed (water gallons), distance from tank to property lines, existing buildings, streets, roads, sidewalks, overhead power lines, pits or Storm/Sewer drains, and all sources of ignition in all directions.

Type of approved vehicle protection to be used. Guard posts or other approved means of protection for tank and piping shall be provided. International Fire Code (2021 Edition) Chapter 3 Section 312 and NFPA 58 (2024 Edition)

Location of minimum 18 lb ABC fire extinguisher within 50 feet of dispenser.

**PLAN REVIEW DRAWING**

